


Cable output length 2m:  
 Power :  
 One shielded class 6 cable coded 1,2,3 green/yellow  
 Thermal sensors :  
 One shielded class 6 cable (2x2x0.25mm<sup>2</sup>)  
 Brown-White : PTC  
 Green-Yellow : KTY84  
 Minimum bending radius (except for the first 50mm) :  
 See table

Cable	Ø	R min.
2x2x0.25	7	84
4x1.5	10.2	120
4x2.5	11.4	135
4x4	13.1	155
4x6	15.9	190
4x10	18.8	225

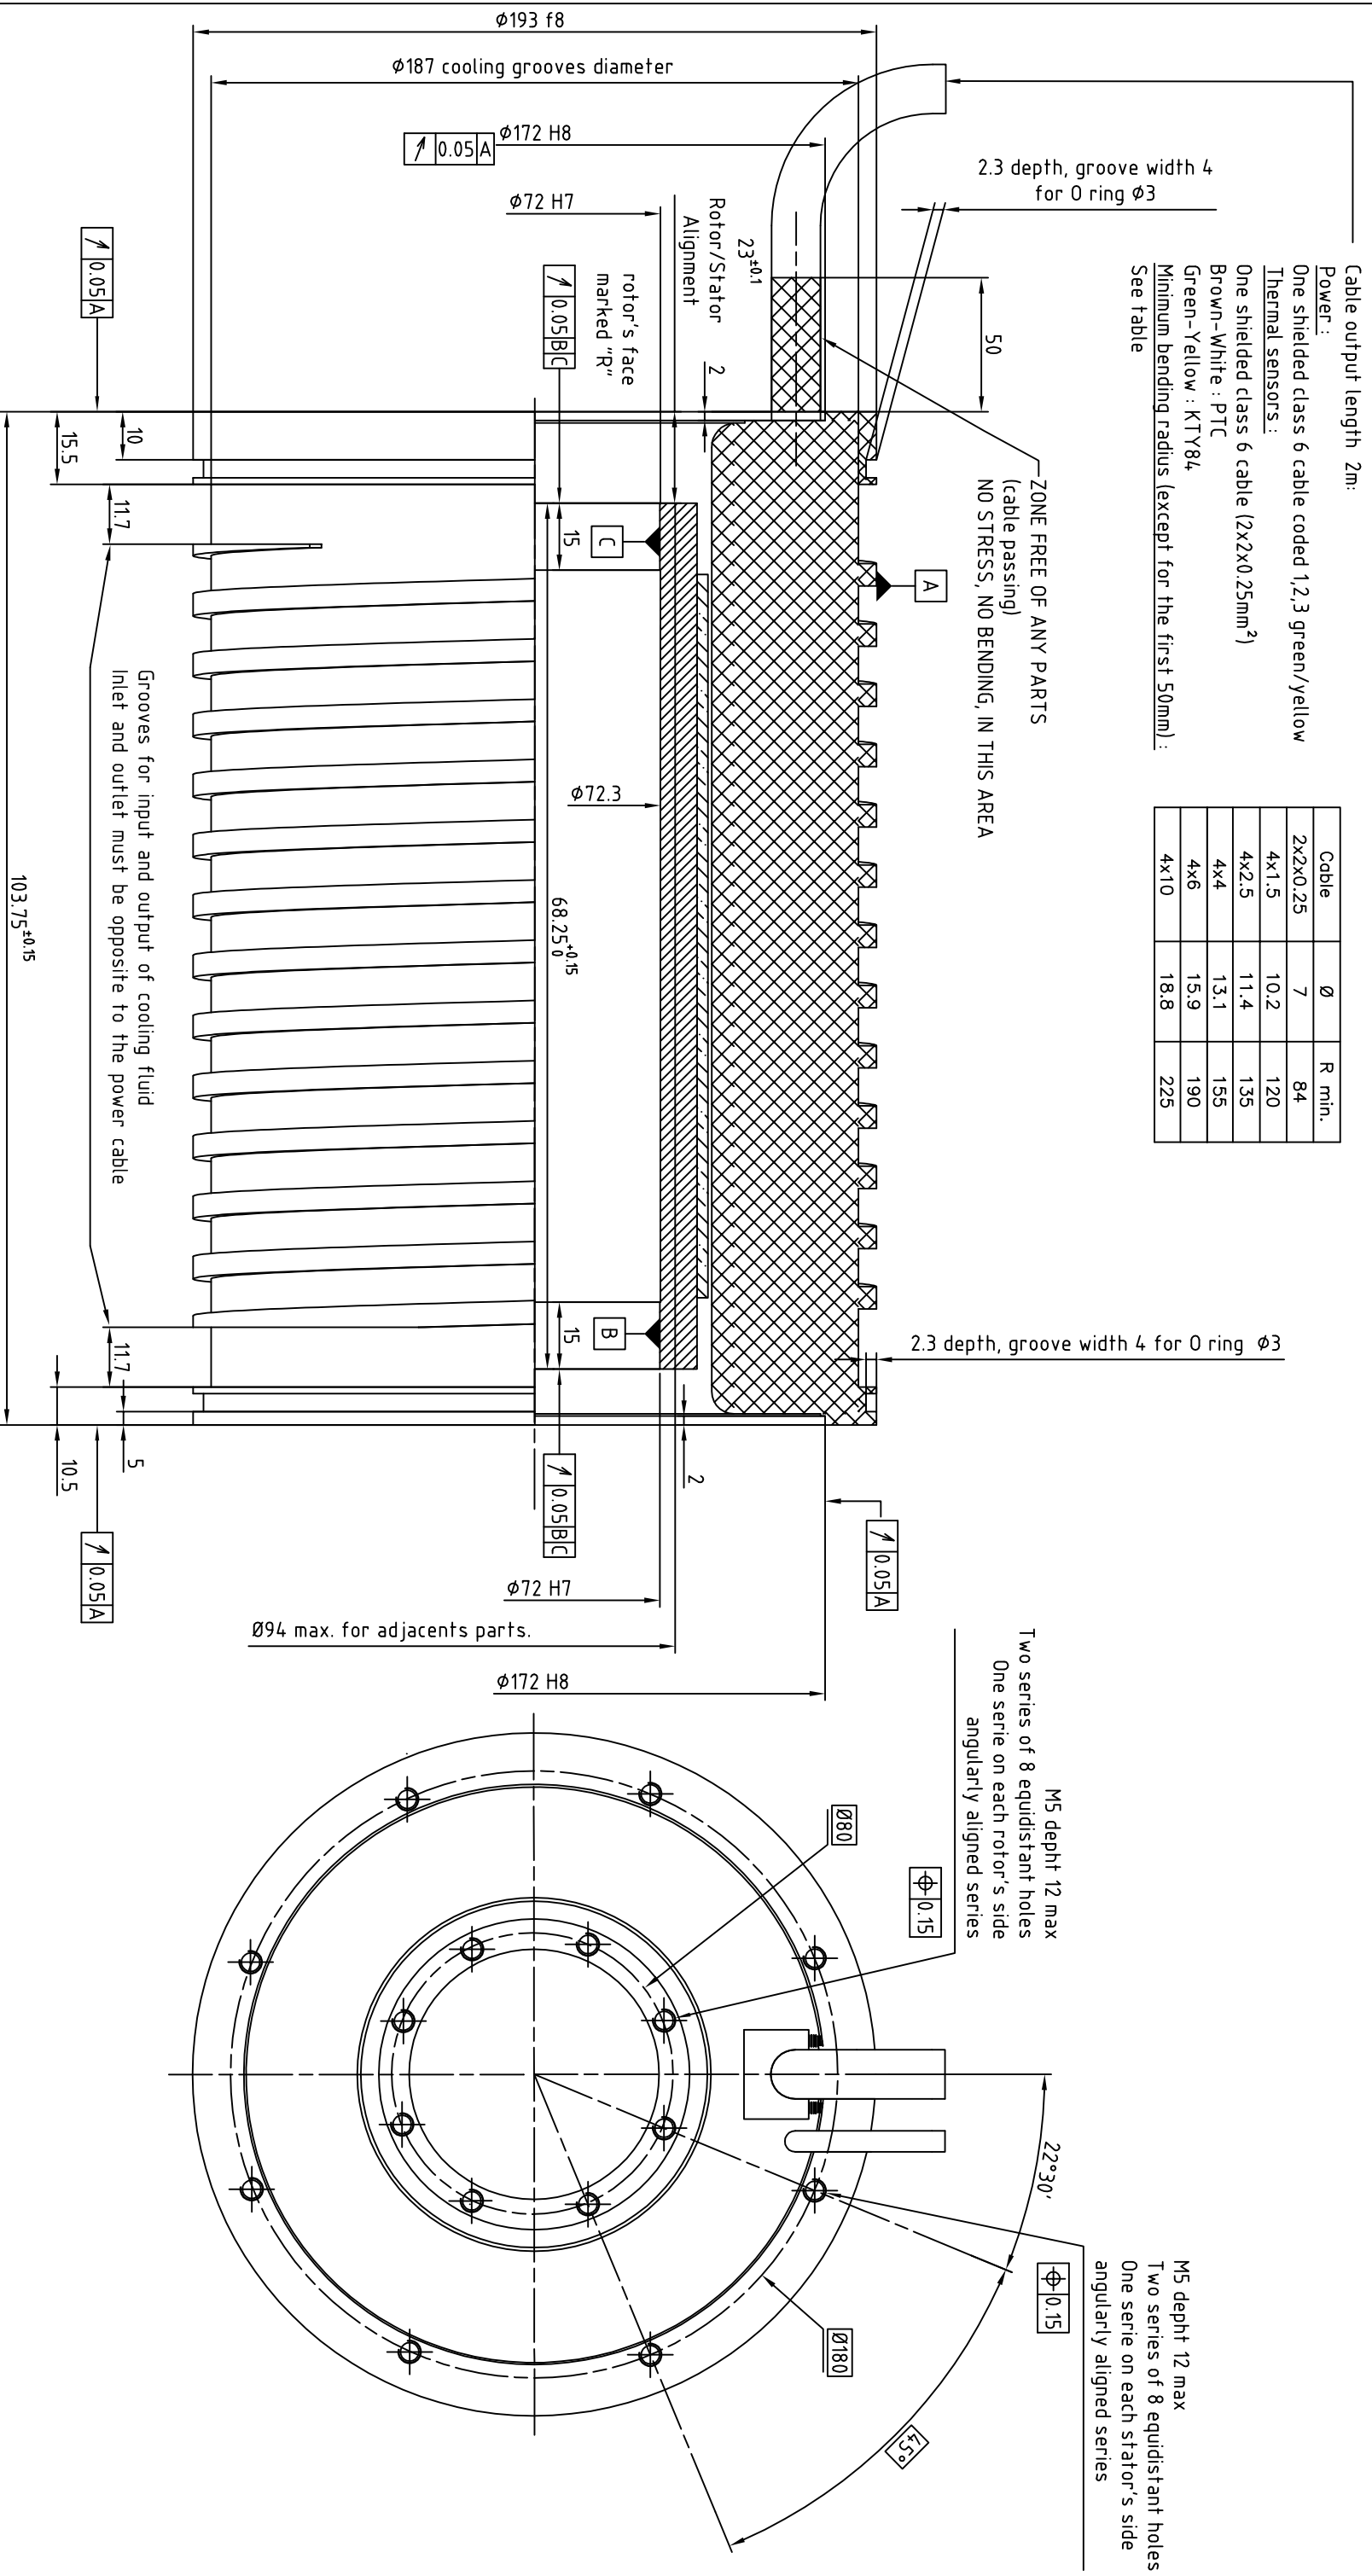

CAUTION: For a better safety, it is recommended that the cooling fluid inlet would be made through the hose located on the side opposed to the cabling, while the cooling fluid outlet will be made by the one located on the cable side.

NOTA:  
 Rotor is not fitted in the stator  
 For more information about mounting see document 190STKO-WA002

**ALXION**

AUTOMATIQUE & PRODUCTIVE  
 Parc Technologique des Fosses Jean  
 92712 COLOMBEES Cedex  
 Tél: 0141306304 - Fax: 0141306136

190STK1M2XXXXXX